

A Comparison of Embedded Cost Based Transmission Pricing Methods

M. Murali, *Student Member, IEEE*, M.Sailaja Kumari, *Member, IEEE* and M.Sydulu, *Member, IEEE*

Abstract--In the restructured power market, it is necessary to develop an appropriate pricing scheme that can provide the useful economic information to market participants, such as generation, transmission companies and customers. Proper pricing method is needed for transmission network to ensure reliability and secure operation of power system. Accurately estimating and allocating the transmission cost in the transmission pricing scheme still remains challenging task. This paper gives an overview of different costs incurred in transmission transaction, types of transmission transactions and the transmission pricing methodologies. Embedded as well as Incremental cost methods are explained. It mainly focussed on determining the embedded transmission cost by various methods and compared the results for 6bus, IEEE 14bus and RTS 24 bus systems.

Index Terms--Bialek Tracing, Embedded cost, GGDF, MVA-Mile, MW-Mile, Postage stamp.

I. INTRODUCTION

THE rapidly changing business environment for electric power utilities all around the world has resulted in unbundling of services provided by these utilities. With the introduction of restructuring into the electric power industry, the price of electricity has become the focus of all activities in the power market. The objective of transmission pricing is to recover all or part of the existing and new cost of transmission system. Pricing of transmission services plays a crucial role in determining whether providing transmission crucial role in determining whether providing transmission services is economically beneficial to both the wheeling utility and the wheeling customers. Engineering analysis which deals mainly with determining the feasibility and the cost of providing transmission services is only one of many considerations in the overall process of pricing transmission services. So, it is important to distinguish between transmission costs and prices.

M.Murali is with the Department of Electrical Engineering, N.I.T, Warangal, AP 506004 INDIA (e-mail: matcha.murali@gmail.com).

M.Sailaja Kumari is with the Department of Electrical Engineering, N.I.T, Warangal, AP 506004 INDIA (e-mail: sailaja_matam@yahoo.com).

M.Sydulu is with the Department of Electrical Engineering, N.I.T, Warangal, AP 506004 INDIA.

A. Categories of Transmission Transactions

The following are the categories [2, 3] of transmission transactions:

1) *Firm Transmission Transactions*: These transactions are not subject to discretionary interruptions and are specified in terms of MW of transmission capacity that must be reserved for the transaction. The transco makes arrangements for enough capacity on the network to meet these transaction needs. These could either be on a long-term basis, in the order of years or on short-term contracts (up to one year).

2) *Non-firm Transmission Transactions*: These transactions may be curtailable or as-available. Curtailable transactions are ongoing transactions that may be curtailed at the utility's discretion. As-available transactions are short-term, mainly economy, transactions that take place when transmission capacity becomes available at specific areas of the system at specific times.

3) *Long-term Transmission Transactions*: Long term transaction is long enough to allow building new transmission facilities.

4) *Short-term Transmission Transactions*: These transactions not associated with transmission reinforcements. Short term transaction may be a bilateral contract or pool trading.

B. Components of the Transmission Cost

The major components of the transmission cost of transmission transactions are: [17].

1) *Operating Cost*: This is the cost due to generation rescheduling and redispatches to minimize the system losses, relieve congested transmission lines and enhance the system voltage profile.

2) *Opportunity Cost*: Benefits of all the transactions that the utility forgoes due to operating constraints. It is defined as costs that may be encountered in the transmission constrained case where the wheeling may prevent may prevent the transmission capacity. In other words it is the profit obtained to ISO during congestion in the system.

3) *Reinforcement Cost*: Capital cost of new transmission facilities needed to accommodate the transaction. It also includes the installation of additional reactive power resources to support the transaction.

4) *Embedded Cost*: The allocated cost of existing transmission facilities used by the transmission transaction. It includes:

- Investment costs (including returns and depreciation of capital equipment) which is the highest proportion of the overall cost.

- Administrative and general costs including scheduling and coordination services, billing and accounting staff, and salaries.
- Investment for operation and maintenance costs.
- Cost of voltage control and reactive power support.

Operating cost, opportunity cost and reinforcement cost constitute the incremental cost of the transmission transaction. Incremental costs are two types. They are short run and long run incremental costs "Short-Run Incremental Cost" refer to operating cost and opportunity cost, "Long-Run Incremental Cost" refers to operating cost, opportunity cost and reinforcement cost. "Congestion Cost" is also called opportunity cost and "Embedded Cost" is also called existing system cost.

II. TRANSMISSION PRICING METHODS

The main objective of any transmission pricing method is to recover the system cost plus some profit. Transmission pricing methods are the overall processes of translating transmission costs into overall transmission charges. These methods are shown in fig1:

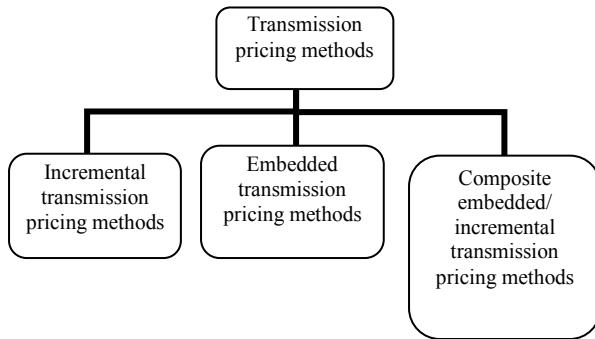


Fig. 1. Different transmission pricing methods

A. Incremental Transmission Pricing

These pricing methods allocate the incremental cost (i.e., variable cost) of the transmission transaction. Fig.2 shows different types of incremental pricing methods.

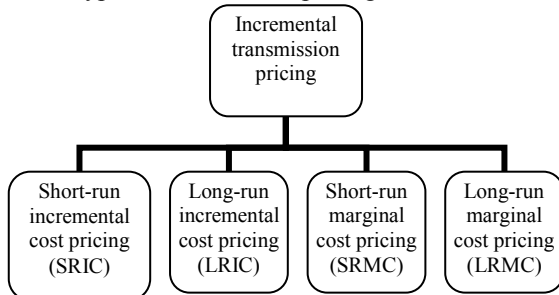


Fig. 2. Types of Incremental transmission pricing methods

1) Short-run Incremental Cost Pricing (SRIC)

This pricing methodology entails evaluating and assigning the operating costs associated with a new transmission transaction to that transaction. The transmission transaction operating costs can be estimated using an optimal power flow (OPF) model that accounts for all operating constraints including transmission system (static or dynamic security) constraints and generation scheduling constraints.

2) Long-run Incremental Cost Pricing (LRIC)

This pricing methodology entails evaluating all long-run costs (operating and reinforcement costs) necessary to accommodate a transmission transaction and assigning such costs to that transaction. The reinforcement cost component of a transmission transaction can be evaluated based on the changes caused in long-term transmission plans due to the transmission transaction.

3) Short-run Marginal Cost Pricing (SRMC)

The short run marginal cost of a Transco is the cost of supplying an additional 1 MW of power in a transaction. SRMC is the difference in marginal costs of supply bus and delivery bus. The marginal costs of two buses can be determined from the optimal power flow solution as the dual variables associated with the demand balance equation. The transaction price can be determined by multiplying the power transaction with the SRMC to obtain SRMC based price.[4,5,6,7] SRMC takes into consideration the variable costs incurred by the transaction i.e., the operating cost but not the reinforcement cost.

4) Long-run Marginal Cost Pricing (LRMC)

LRMC determines the present value of future investments required to support a marginal increase in demand at different locations in the system, based on peak scenarios of future demands and supply growth [8]. In this pricing methodology the marginal operating and reinforcement costs of the power system are used to determine the prices for a transmission transaction.

B. Embedded Transmission Pricing

These pricing methods allocate the embedded system costs i.e., fixed cost among transmission system users. Embedded pricing methods can be categorized as in fig3:

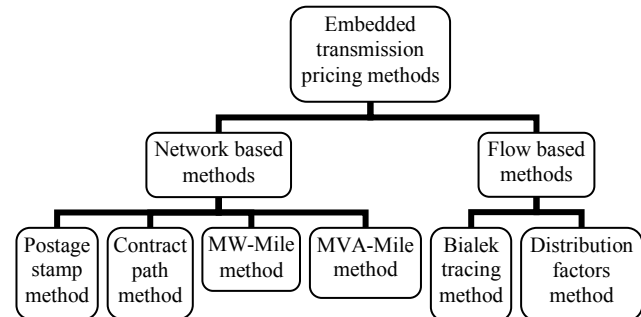


Fig. 3. Types of Embedded transmission pricing methods

1) Network-Based Methods

These methods depend on the structure of the transmission system but do not recognize the physical laws governing its operation [8].

a) Postage Stamp Method

Postage-stamp rate method is traditionally used by electric utilities to allocate the fixed transmission cost among the users of firm transmission service. This method is an embedded cost method, which is also called the rolled-in embedded method. This method does not require power flow calculations and is independent of the transmission distance and network configuration. The magnitude of the transacted power for a particular transmission transaction is usually measured at the time of system peak load condition:

$$R_t = TC * (P_t / P_{\text{peak}}) \quad (1)$$

Where R_t is the transmission price for transaction t , TC is the total transmission charges and P_t and P_{peak} are transaction t load and the entire system load at the time of system peak load condition [13]. The main purpose of using this methodology is the entire system is considered as a centrally operated integrated system. This method is simpler. Since this method ignores the actual system operation, it is likely to send incorrect economic signal to transmission customers.

b) Contract Path Method

In this method a specific path between the points of delivery and receipt is selected for a wheeling transaction. This path is called the “contract path” and is selected by the utility company and the wheeling customer usually without performing a power flow study to identify the transmission facilities that are actually involved in the transaction [13]. This method also ignores the actual system operation.

c) Distance Based MW-Mile Method

This method allocates the transmission charges based on the magnitude of transacted power and the geographical distance between the delivery point and the receipt point i.e., it is the product of power due to a transaction times the distance this power travels in the network [8]. This method is DC power flow based method.

$$TC_t = TC \times \frac{\sum_{k \in K} C_k L_k MW_{t,k}}{\sum_{t \in T} \sum_{k \in K} C_k L_k MW_{t,k}} \quad (2)$$

- In (2) TC_t = cost allocated to transaction t
 TC = total cost of all lines in \$
 L_k = length of line k in mile
 C_k = cost per MW per unit length of line k
 $MW_{t,k}$ = flow in line k , due to transaction t
 T = set of transactions
 K = set of lines

d) MVA-Mile Method

The MVA-mile method is an extended version of the MW-mile method. It takes into consideration both real power and reactive power where as MW-mile method considers only real power. This method also allocates the transmission charges based on the magnitude of power and the geographical distance between the delivery point and the receipt point. This method is AC power flow based method.

2) Flow Based Methods

This approach allocates the charges of each transmission facility to a wheeling transaction based on the extent of use of that facility by the transaction. This is determined as a function of magnitude, the path, and the distance travelled by the transacted power. The flow based methods are Bialek tracing method and Distribution factors method.

a) Bialek Tracing Method

This algorithm works only on lossless flows when the flows at the beginning and end of each line are the same. The simplest way of obtaining lossless flows from the lossy ones is by assuming that a line flow is an average over the sending and receiving end flows and by adding half of the line loss to the power injections at each terminal node of the line [14]. The total flow P_i through node i (i.e., the sum of inflows or outflows) may be expressed, when looking at the inflows as [15]

$$P_{ij}^g = \frac{P_{ij}^g}{P_i^g} \sum_{k=1}^n [A_u^{-1}]_{ik} P_{Gk} ; j \in \alpha_i^d \quad (3)$$

In (3)

$$P_i^g = \sum_{j \in \alpha_i^d} |P_{ij}^g| + P_{Gi}$$

$$[A_u]_{ij} = \begin{cases} 1 & i=j \\ -\frac{|P_{ji}|}{P_j} & j \in \alpha_i^u \\ 0 & \text{otherwise} \end{cases}$$

and

- P_{ij}^g = an unknown gross line flow in line i - j
 P_i^g = an unknown gross nodal power flow through node i
 A_u = upstream distribution matrix
 P_{Gk} = generation in node k
 α_i^d = set of nodes supplied directly from node i
 α_i^u = set of buses supplying directly to bus i

b) Distribution Factors Method

Distribution factors are calculated based on DC load flows. These factors are used to determine the impact of generation and load on transmission flows. The various distribution factors are Generation shift distribution factors (GSDF's) and Generalized Generation/ load distribution factors (GGDF's/GLDF's) have been used extensively in power system security analysis to approximate the transmission line flows and generation /load values. GSDF's or A factors provide line flow changes due to a change in generation. These factors can be used in determining maximum transaction flows for bounded generation and load injections. GGDF's are applied to estimate the contribution by each generator [15,16] to the line flow on the transmission grid and GLDF's determine the contribution of each load to line flows.

III. CASE STUDIES

TABLE I POSTAGE STAMP METHOD RESULTS FOR 6 BUS SYSTEM

Line k	Line cost C_k (\$)	Postage stamp method		
		G1	G2	G3
		$C_k MW_{1,k}$	$C_k MW_{2,k}$	$C_k MW_{3,k}$
1	10	97.05	97.05	97.05
2	10	145.647	145.647	145.647
3	10	118.766	118.766	118.766
4	10	9.9452	9.9452	9.9452
5	10	110.92	110.92	110.92
6	10	51.64	51.64	51.64
7	10	88.094	88.094	88.094
8	10	64.42	64.42	64.42
9	10	145.39	145.39	145.39
10	10	14.028	14.028	14.028
11	10	5.699	5.699	5.699
Total	110	851.5992	851.5992	851.5992
Loss cost (\$)		84.46295		
Total cost of each generator (\$)		879.75	879.75	879.75
Total cost (\$)		2639.26		
Each transaction cost (\$)		36.666	36.666	36.666
Cost (\$/MW)		0.3381	0.7333	0.6111

TABLE II MW-MILE AND MVA-MILE METHOD RESULTS FOR 6 BUS SYSTEM

Line k	Line cost $C_k L_k$ (\$)	MW-Mile method			MVA-Mile method		
		G1	G2	G3	G1	G2	G3
		$C_k L_k MW_{1,k}$	$C_k L_k MW_{2,k}$	$C_k L_k MW_{3,k}$	$C_k L_k MW_{1,k}$	$C_k L_k MW_{2,k}$	$C_k L_k MW_{3,k}$
1	5780	48799.306	48799.306	48799.306	62662.8052	62662.8052	62662.8052
2	2890	40043.035	40043.035	40043.035	47445.2794	47445.2794	47445.2794
3	4630	51091.240	51091.240	51091.240	59595.4346	59595.4346	59595.4346
4	2890	1785.7399	1785.7399	1785.7399	10631.3720	10631.3720	10631.3720
5	2890	31286.763	31286.763	31286.763	57534.290	57534.290	57534.290
6	5780	31248.418	31248.418	31248.418	46444.7241	46444.7241	46444.7241
7	4050	33450.487	33450.487	33450.487	41204.1692	41204.1692	41204.1692
8	6940	39168.677	39168.677	39168.677	76575.1978	76575.1978	76575.1978
9	1160	17369.841	17369.841	17369.841	30106.1825	30106.1825	30106.1825
10	11560	15585.863	15585.863	15585.863	18560.1565	18560.1565	18560.1565
11	5780	577.7244	577.7244	577.7244	17827.2732	17827.2732	17827.2732
Total	54350	310407.1	310407.1	310407.1	468586.885	468586.885	468586.885
Total cost (\$)		931221.297755			1405760.655195		
Each transaction cost (\$)		18116.666	18116.666	18116.666	18116.6666	18116.6666	18116.6666
Cost (\$/MW)		181.1667	362.3333	301.9444	167.0674	362.3333	301.9444

TABLE III GGDF METHOD AND BIALEK TRACING METHOD RESULTS FOR 6 BUS SYSTEM

Line k	Line cost $C_k L_k$ (\$)	GGDF method			Bialek Tracing method		
		G1	G2	G3	G1	G2	G3
		$C_k L_k MW_{1,k}$	$C_k L_k MW_{2,k}$	$C_k L_k MW_{3,k}$	$C_k L_k MW_{1,k}$	$C_k L_k MW_{2,k}$	$C_k L_k MW_{3,k}$
1	5780	219029.69	35018.412	18418.558	168052.644	0.0	0.0
2	2890	109852.11	5149.93	9651.0357	126504.836	0.0	0.0
3	4630	146982.76	18118.268	2726.388	164786.76	0.0	0.0
4	2890	29746.69	21583.681	42766.388	3244.213	5579.07	0.0
5	2890	5683.118	47627.691	40491.9099	35534.37	61108.42	0.0
6	5780	35292.271	44959.7085	7670.2065	33306.7059	57277.515	0.0
7	4050	75276.153	47708.54	17204.41	40071.716	68911.298	0.0
8	6940	5981.512	18818.158	117016.08	2359.01832	4056.8019	126087.205
9	1160	12265.054	5206.903	32502.115	907.872	1561.268	48524.9051
10	11560	52397.666	22182.958	26141.296	36607.791	13805.576	0.0
11	5780	34827.098	260.148	24869.9117	6068.986	1581.2868	2457.914
Total	54350	727334.15	266634.418	339458.307	617444.916	213881.248	177070.024
Total cost (\$)		1333426.8758			1008396.1893		
Each transaction cost (\$)		29645.878	10867.923	13836.198	33278.716	11527.65745	9543.6257
Cost (\$/MW)		273.386	217.358	230.6033	306.888	230.5531	159.06

TABLE IV COMPARISON OF VARIOUS METHODS FOR IEEE 14 BUS SYSTEM

Postage stamp method			MW-Mile method		MVA-Mile method		GGDF method		Bialek tracing method	
Total cost (\$)	G1	G2	G1	G2	G1	G2	G1	G2	G1	G2
	6768.94016		73255.175833		77261.457849		73906.67975		78062.34683831	
Each transaction cost (\$)	100	100	1361.67	1361.67	1361.67	1361.67	2343.522	379.827	2429.098	294.251
Cost (\$/MW)	0.43	2.5	6.2177	34.0419	5.8593	34.0419	10.701	9.4957	10.4452	7.3563

TABLE V COMPARISON OF VARIOUS METHODS FOR RTS 24 BUS SYSTEM

	G1	G2	G3	G4	G5	G6	G7	G8	G9	G10
Postage stamp method Total cost=60082.95										
Each transaction cost (\$)	34	34	34	34	34	34	34	34	34	34
Cost (\$/MW)	-0.126	0.177	0.113	0.057	0.158	0.219	0.085	0.085	0.113	0.0515
MW-MILE method Total cost=277997.312276										
Each transaction cost (\$)	212.34	212.34	212.34	212.34	212.34	212.34	212.34	212.34	212.34	212.34
Cost (\$/MW)	-0.585	1.1059	0.7078	0.3593	0.9876	1.3699	0.5309	0.5309	0.7078	0.3217
MVA-MILE method Total cost=271847.739937										
Each transaction cost (\$)	212.34	212.34	212.34	212.34	212.34	212.34	212.34	212.34	212.34	212.34
Cost (\$/MW)	-0.792	1.1059	0.7078	0.3593	0.9876	1.3699	0.5309	0.5309	0.7078	0.3217
GGDF method Total cost=862526.4524										
Each transaction cost (\$)	378.98	199.63	302.87	313.04	94.39	65.43	168.64	164.79	155.09	280.51
Cost (\$/MW)	-1.044	1.0398	1.0096	0.5297	0.439	0.4221	0.4216	0.412	0.517	0.425
Bialek tracing method: Total cost = 262640.92634										
Each transaction cost (\$)	0	14.45	113.72	391.49	109.11	88.64	124.02	259.301	420.07	602.59
Cost (\$/MW)	0	0.0753	0.3791	0.6624	0.5075	0.5719	0.3101	0.6483	1.4	0.913

Tables I to V present the cost of one MW generation for each generator using various pricing methods applied to 6 bus system, IEEE 14 bus system and RTS 24 bus systems. 6 bus system [19] has generators at bus numbers 1, 2, 3. In this paper line lengths are assumed to be proportional to the line reactance. For transformers line lengths are neglected and are taken as zero. Postage stamp method doesn't consider system line lengths, and hence gives a very inferior result compared to other methods. MW-Mile method uses DC power flow solution and accounts for line lengths. MVA-mile method uses AC power flow and also accounts for the line lengths. GGDF method uses DC power flow and Power transfer Distribution factors for pricing and traces the actual power flow of each line by each participant. Bialek tracing method uses AC power flow algorithm and it also traces the actual power flow of each line by each participant. The results shows that, power flow tracing based methods present more accurate pricing compared to postage stamp method, MW-Mile method and MVA-Mile method. Tables I to III illustrates cost per MW generation for each generator using various pricing methods for 6 bus system. Table IV illustrates comparison of cost per MW generation for each generator using various methods for IEEE 14 bus system [18] which has Generators at bus numbers 1, 2. Flow based Bialek tracing method is the best way of transmission pricing, which considers AC power flow and total line flows. Table V demonstrates the results obtained for RTS 24 bus system [20] containing 10 generators. In all the methods for all bus systems transmission charges are allocated to generators only.

Fig.4 shows the cost per Mw for 3 generators, 6 bus system. Since postage stamp method values are near to zero, they are not visible in fig.4.

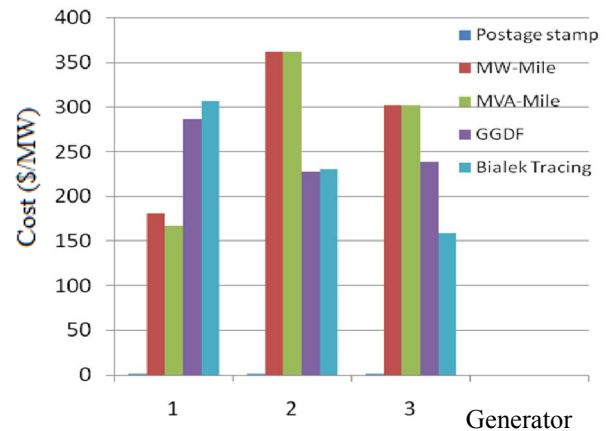


Fig. 4. Comparison of 6 bus system results for different methods

IV. CONCLUSION

In this paper embedded cost based methods of transmission pricing have been discussed. Different cost components incurred by the transmission transaction were explained. Case studies of postage stamp method, MW-Mile method, MVA-Mile method, Distribution factors method and Bialek tracing method for 6bus, IEEE 14bus and RTS 24 bus systems are presented. Postage stamp method for calculating embedded cost provides a very inferior solution compared to other network based and flow based methods. Bialek tracing method is the best way of transmission pricing, among all embedded cost based methods. It is observed that combination of incremental and embedded cost based methods could result in the recovery of true transmission system costs.

V. REFERENCES

- [1] P.S. Kulkarni, O.P. Yadav, "SRMC based Transmission Pricing for Wheeling Transactions under Deregulated Environment of Power Sector", IE (I) Journal-EL, May 2008.
- [2] R.A.Wakefield, J.S.Graves and F.Vojdani, "A transmission services costing framework", *IEEE Transactions on Power systems*, vol 12, No.2, May.1997
- [3] D.Shirmohammadi, C.Rajagoapalan, E.R.Alward and C.L.Thomas, "cost of transmission transactions: An introduction", *IEEE Transactions on Power systems*, Nov.'91, pp.1546-1556
- [4] D.Shirmohammadi, P.R.Gribik, E.T.K.Law, J.H.Malinowski and R.E.O Donnel, "Evaluation of transmission network capacity use for wheeling transactions", *IEEE transactions on Power Systems*, Oct.'89, pp.1405-1413
- [5] Y.Z.Li and A.K.David, "wheeling rates of reactive power flow under marginal cost pricing", *IEEE Transactions on Power Systems*, Aug.'94, pp.1263-1269
- [6] C.W.Yu and A.K.David, "Pricing transmission services in the context of industry deregulation", *IEEE Transactions on Power systems*, Feb.'97, pp.503-510.
- [7] M.C.Caramanis, R.E.Bohn and F.C.schweppe, "The cost of wheeling and optimal wheeling rates", *IEEE Transactions on Power Systems*, Feb.'86, pp.63-73.
- [8] Mohamed A.M.Shaaban, "Cost-based pricing of transmission system services: An overview", http://ipac.kacst.edu.sa/eDoc/2005/146505_1.pdf
- [9] M.B. Rosenzweig, J. Bar-Lev, "Transmission Access and Pricing: Some Other Approaches", *Public Utilities Fortnightly*, August 21, 1986, pp. 20-26.
- [10] A.S. Holmes, "A Review and Evaluation of Selected Wheeling Arrangements and a Proposed General wheeling Tariff, FERC Paper, September 1983.
- [11] D. Shirmohammadi, "An Engineering Perspective of Transmission Access and Wheeling", *Proceedings of the 3rd International Symposium of Specialists in Electric Operational and Expansion Planning (SEPOE III)*, Belo- Horizonte, Brazil, 1992.
- [12] P.R. Gribik, D. Shirmohammadi, S. Hao, C.L. Thomas, "Optimal Power Flow Sensitivity Analysis", *IEEE Transaction on Power Systems*, Vol. 5, No. 3, August 1990, pp. 969-976.
- [13] D. Shirmohammadi, Xisto Vieira, Boris Gorenstin, Mario V.P.Pereira, "Some fundamental technical concepts about cost based transmission pricing", *IEEE Transactions on Power Systems*, Vol. 11, No. 2, May 1996
- [14] J. Bialek, "Tracing the flow of electricity", *IEE Proc-Gener. Transm. Distrib.*, Vol 143, No.4 July1996
- [15] Mohammad Shahidehpour, Hatim Yamin, Zuyi Li, "Market operations in Electric Power Systems"
- [16] O.P.Rahi, Y.R.Sood, R.C.Chauhan, "Transmission pricing methodologies under restructured environment: An overview", NPSC 2004 paper
- [17] Kankar Bhattacharya, Math H.J.Bollen, Jaap E.Daelder, "Operation of Restructured Power Systems"
- [18] P.K.Iyambo, R.Tzoneva, "Transient Stability Analysis of the IEEE 14-Bus Electric Power System", IEEE conference, Africon 2007
- [19] Ching-Tzong Su, Ji-Hong Liaw, "Power wheeling pricing using power tracing and MVA-KM method", *IEEE Proto Power Tech Conference*, Proto, Portugal, 2001
- [20] P.F. Albrecht, M.P.Bhavaraju, B.E. Biggerstaff, R.Billinton, G.Elsoe Jorgensen, N.D.Reppen, P.B. Shortley, "IEEE Reliability Test System", *IEEE Transaction on Power Apparatus and Systems*, Vol. 1, PAS-98, No. 6, Nov. /Dec. 1979, pp. 2047-2054.



Matcha Murali was born in India, on February 20, 1985. He obtained his B.Tech Degree in Electrical Engineering from Jawaharlal Nehru Technological University, Hyderabad, Andhra Pradesh, India in 2006 and M.Tech degree in Power Systems from National Institute of Technology, Tiruchirapalli, Tamilnadu, India in 2008. Currently he is pursuing PhD at National Institute of Technology, Warangal, Andhra Pradesh, India. His present interests include Transmission Pricing, Artificial Intelligence & Meta heuristic technique applications in Power System, Operation and control of Power System and Power System Deregulation.



Matam Sailaja Kumari was born in India, on August 30, 1972. She obtained her B.E and M.E degrees from University College of engineering, Osmania University, Hyderabad, Andhra Pradesh, India in 1993, 1995 and Ph.D in 2008 from National Institute of Technology, Warangal. She joined Department of Electrical Engineering, National Institute of technology, Warangal, India in 1997 as Lecturer. Currently she is Associate Professor in the Dept. Of Electrical Engineering, NIT Warangal. Her research interests are in the area of Power system Deregulation, Transmission pricing, Application of neural networks and genetic algorithms.



Maheswarapu Sydulu obtained his B.Tech (Electrical Engineering, 1978), M.Tech (Power Systems, 1980), Ph.D (Electrical Engineering – Power Systems, 1993), all degrees from Regional Engineering College, Warangal, Andhra Pradesh, India. His areas of interest include Real Time power system operation and control, ANN, fuzzy logic and Genetic Algorithm applications in Power Systems, Distribution system studies, Economic operation, Reactive power planning and management. Presently he is Professor of Electrical Engineering, at National Institute of Technology, Warangal (formerly RECW).